

SOLAR INFORMATION

for Louisiana Residents

Terrence L. Chambers, Ph.D., P.E.
terrence.chambers@louisiana.edu
Louisiana Solar Energy Lab
Energy Institute of Louisiana
University of Louisiana at Lafayette
Updated 12-6-2024

Disclaimer: This document represents the professional opinion of the author and does not necessarily reflect the position of the University.

Solar Guidance Documents from Other States

Because members of the public are often concerned about potential solar development in their state, public universities are often called upon to provide unbiased answers to common concerns as a resource guide for public officials when making solar-related policy decisions. Two excellent examples are, “Health and Safety Impacts of Solar Photovoltaics,” which was written by the North Carolina Clean Energy Technology Center¹, and “Clean Energy Results, Questions and Answers, Ground-Mounted Solar Photovoltaic Systems,” created by the Massachusetts Clean Energy Center². In a similar vein, this document attempts to summarize the issues of particular interest to Louisiana residents related to potential solar energy development.



Figure 1 – Louisiana Solar Energy Lab at the University of Louisiana at Lafayette (UL Lafayette)

Health and Safety Impacts of Solar Power Plants

Hazardous Materials

Although solar energy systems do contain small amounts of toxic materials, the issue has been studied extensively and the conclusion is that these materials do not present a danger to public health^[3,4,5,6]. Solar cells are semi-conductors and contain the same type of semi-conductor materials as are used in the computer industry. Unlike computers, however, solar modules are designed to be installed outdoors. Because the semi-conductor would be ruined if exposed to the elements, the solar cell itself is encapsulated in plastic. In addition, the cells are protected either by a layer of tempered glass on both top and bottom, or by tempered glass on the top and a polymer sheet on the back. As result, the solar cell is completely protected from air and water during normal operation, and as such, rainwater does not wash any toxic materials into the soil. The tempered glass on the front of a solar module is very durable and hard to break, but even if the glass on the solar module is broken, the plastic encapsulant normally still keeps the semi-conductor portion of the modules from being exposed to the elements, thus preventing any harmful materials from escaping. In general, the toxic materials in a solar module will not leach out into the environment unless the solar module is so severely damaged that the encapsulant is compromised, and the cell pieces are fully immersed in water for an extended amount of time. Even then, according to the International Energy Agency, the concentrations of the toxic materials in the water would remain “several orders of magnitude below regulatory screening thresholds⁷.”

End of Life, Recycling, Decommissioning

The situation described above where a defective solar module is immersed in water for a long period of time does not occur during general use, but it could occur if the module were deposited in a landfill at the end of life. Therefore, it is not a recommended practice to place used modules in landfills, and local jurisdictions have the authority to prevent that from happening. Instead, it is recommended to recycle them at the end of their useful life^[8,9,10]. Major module manufacturers¹¹ and solar industry trade associations¹² have recycling programs, and recycling is highly recommended at the end of life.

In general, all components of a solar project can be removed from the property at the end of a solar project and the land can be restored to its original state. The solar modules can be unbolted and recycled. The steel racks that support the solar modules can be removed and either re-purposed or recycled. A decision can be made to either remove the underground PVC conduits that carry the electrical conductors, or to pull the conductors out and leave the conduits in the ground if they are deep enough to not interfere with the next intended purpose for the land. Many of the materials recovered at the decommissioning of a solar farm, including many tons of steel, have an inherent salvage value, making the decommissioning process less costly to the project owner than it would be otherwise. Decommissioning bonds are now required in Louisiana to ensure that neither the landowner nor the local jurisdiction will be left on the hook to decommission a solar power plant if the solar plant owner goes out of business.

THE RECYCLING PROCESS

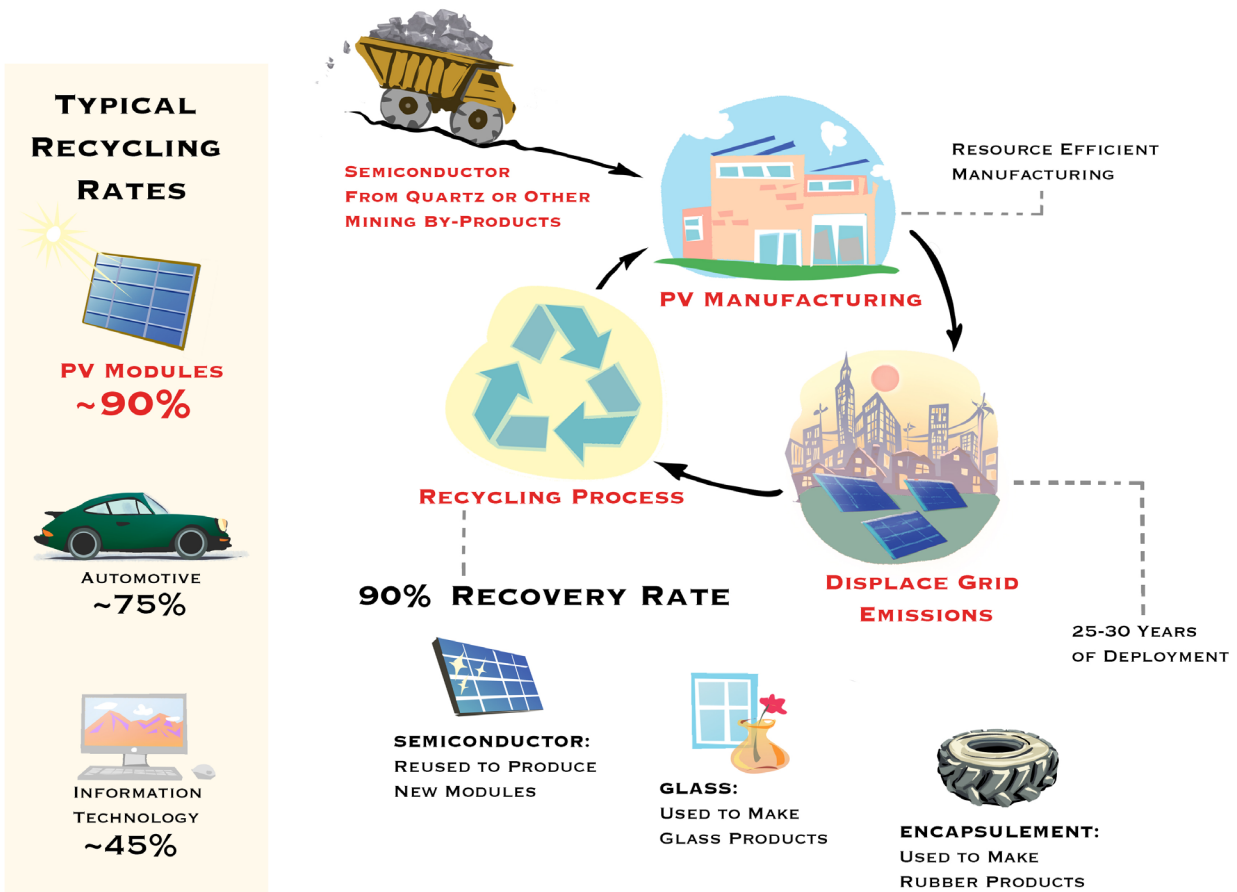


Figure 2 - Solar Panel Recycling Process

O&M – Panel Washing and Vegetation Control

One common concern is that the chemicals used to wash the solar modules will be harmful to the groundwater. Louisiana has enough rain that the modules do not need to be washed very often – in general about once a year. Washing of the modules is accomplished using tap water run through a deionization filter, a pressure washer, and a rotating brush. No chemicals are needed. If any chemicals are used, it would likely be a mild soap to remove a particularly stubborn bit of soiling. In Louisiana, according to soiling studies we have conducted, the most common type of stubborn soiling results from pollen and bird droppings.

Utility-scale solar plants typically have grass beneath the modules and between the rows. Vegetation control is primarily accomplished by planting a species of grass that has a limited height, so that it does not shade the solar modules, and then by mowing and weed eating as necessary. It is also possible to allow sheep to graze in a solar field to keep the vegetation down, and to plant pollinator plants

along the vegetative visual barrier around the solar facility. In general, herbicides are only used at strategic sites, such as along the fence lines and next to the electrical equipment. When an herbicide is used, it is usually a general-use herbicide available over the counter, of the same type used in lawns and parks across the country, rather than a special use herbicide that requires a license.



Figure 3 - Student Worker Washing Solar Panels at the Louisiana Solar Energy Lab

Hurricanes

Existing local building codes already require all structures, including solar power plants, to be engineered to withstand the design windspeed for each location, as specified by the American Society of Civil Engineers (ASCE). Typical design windspeeds in Louisiana can vary from 110 mph to 140 mph, but solar racks can easily be designed to windspeeds of 150 mph or higher. The National Renewable Energy Lab used maintenance data from 50,000 operational solar energy systems and found that solar plants stand up well to hurricanes and hail¹³. This has been confirmed by the experience of solar plants in New Jersey and New York during Hurricane Sandy, and by solar plants in the US and Caribbean during Hurricane Mathew, which for the most part survived all of these devastating storms with only minor damage¹.

Electromagnetic Fields (EMF)

Photovoltaic systems do generate both electric and magnetic fields, which are sometimes called EMFs. The type and magnitude of the electric and magnetic fields generated by solar energy equipment is similar to the electric and magnetic fields produced by other electrical equipment that surrounds us every day, including electrical power lines, electrical sub-stations, cell phones, and microwave ovens. Because this is a persistent source of concern, a brief technical explanation seems warranted in order to help the public understand why the electromagnetic fields generated by solar power plants do not represent a unique danger to human health or safety.

The strength of an electric field is proportional to voltage, while the strength of a magnetic field is proportional to current. Both types of electromagnetic fields diminish exponentially with the distance from the source. Electric fields are very easily absorbed and are shielded by anything between a person and the source of the electric field, such as a tree, a fence, or a building. On the other hand, magnetic fields easily pass through most objects, including humans, making magnetic fields the more significant issue with regard to human health. There is also an important distinction between the static magnetic fields produced by DC electricity, and the “power frequency” magnetic fields produced by AC electricity. Static magnetic fields do not induce an electrical current in the human body, but very high current AC electricity does induce a power frequency magnetic field, which under certain circumstances could potentially induce an electric current in the human body large enough to cause pain or headaches. Whether this presents a danger to public health has been studied extensively, including by the National Institute of Environmental Health¹⁴, the World Health Organization¹⁵, and National Academies of Science¹⁶. Following a comprehensive evaluation of this issue, the National Academies of Science concluded:



NATIONAL ACADEMY OF SCIENCES

“Based on a comprehensive evaluation of published studies relating to the effects of power frequency electric and magnetic fields on cells, tissues, and organisms (including humans), the conclusion of the committee is that the current body of evidence does not show that exposure to these fields presents a human-health hazard. Specifically, no conclusive and consistent evidence shows that exposures to residential electric and magnetic fields produce cancer, adverse neurobehavioral effects, or reproductive and developmental effects¹⁶.”

Exposure limits for public safety have also been established by the Institute of Electrical and Electronics Engineers (IEEE)¹⁷, and the International Commission on Non-Ionizing Radiation Protection (ICNIRP)¹⁸. The typical electrical equipment that we use every day are designed to comply with IEEE and ICNIRP standards.

It is reasonable to ask whether solar power plants present a unique risk to human health, and This question has been asked when other solar projects have been proposed and studies have been performed to answer the question, including by the US Department of Energy, which concluded that:

“...the magnitude of EMF exposure measured at the perimeter of PV installations has been shown to be indistinguishable from background EMF, and is lower than that from many household appliances, such as televisions and refrigerators¹⁹.”

These studies show that the DC voltage generated within the solar field produces a static electric field that will usually be largest at the end of the longest string of modules. The DC current produces a static magnetic field that does not induce a current in the human body. This static EMF is relatively small in magnitude and diminishes dramatically with distance, such that at a distance of 10 feet it is “largely indistinguishable from the Earth’s natural magnetic field²⁰.” The inverters, AC combiner panels, and transformers in a solar field are the largest sources of power frequency EMF. The power frequency electromagnetic fields in a solar plant are of the same type and magnitude as would be found with traditional electrical equipment, including electrical substations, power lines, and the transformers we see around town and behind our houses. This magnetic field diminishes rapidly with distance and is nearly un-detectable at the fence of a solar facility. A recent peer-reviewed study entitled, “Electromagnetic Fields Associated with Commercial Solar Photovoltaic Electric Power Generating Facilities²¹” measured the EMF generated at two commercial solar power plants and concluded:

“Static magnetic fields were very small compared to exposure limits established by IEEE and ICNIRP. The highest 60-Hz magnetic fields were measured adjacent to transformers and inverters, and radiofrequency fields from 5–100 kHz were associated with the inverters. The fields measured complied in every case with IEEE controlled and ICNIRP occupational exposure limits. In all cases, electric fields were negligible compared to IEEE and ICNIRP limits across the spectrum measured and when compared to the FCC limits (≥ 0.3 MHz).”

These results have been confirmed at the Louisiana Solar Energy Lab by taking EMF measurements at various locations throughout the University’s solar facility and along the fence line. The readings outside the fence were at the ambient levels found throughout town and inside a typical home, while the highest readings inside the fence were found beneath a typical power line that runs alongside the solar field to serve an adjoining neighborhood, but that is not even connected to the solar facility.

Concerns have been expressed about solar facilities potentially interfering with pacemakers. The standards to which Active Implanted Medical Devices (AIMSs) are manufactured requires them to be immune to EMF interference under “reasonable foreseeable” circumstances, which include exposure to EMFs associated with common electrical equipment and power lines, to the extent they are accessible by the general public. As a result, neither the US Food and Drug Administration (FDA) nor the UK’s Medicines and Healthcare products Regulatory Agency (MHRA) has ever seen a documented case of a patient having their implanted heart device interfered with by a high-voltage power line²². As discussed above, since the EMFs from a solar facility outside the fence are much lower than that of a typical power line, there is no reason to believe that EMFs from a solar facility would interfere with a pacemaker or other AIMS.

Electric Shock and Arc Flash

Solar energy plants are electrical power generation facilities, and as such there is a very real danger from electrical shock and arc flash. For that reason, typical building codes and the National Electric Code (NEC) require that warning signs and tall fences be installed to prevent the general public from inadvertently accessing any electrical equipment that could cause them harm. Qualified electrical technicians and other workers who are specially trained to identify and mitigate these types of hazards and can safely operate and maintain a solar facility.



Fire Hazards

The components that make up a solar field are mostly made of steel, glass, and aluminum which are not flammable. In general, therefore, even if the grass underneath a solar array catches fire, the solar modules will not catch fire. On the other hand, an arc flash caused by a loose connector or a frayed wire could potentially generate enough heat to ignite the plastic back sheet, the plastic encapsulant, and the insulation on the wires for a solar module, making fire a realistic, though rare, possibility. Recent editions of the National Electric Code (NEC), published by the National Fire Protection Association, have a special chapter for solar facilities outlining design requirements to ensure that solar energy systems are designed and installed in a way that is safe for the public and that will allow firefighters to perform their job safely. Because a solar module will create an electrical potential whenever it is in the sunlight, the NEC requires the installer of a solar energy system to provide an easily identifiable location where firefighters can de-energize the PV system so that they can safely fight a




fire at a solar plant or a building with a rooftop PV system installed. The US Department of Energy has provided millions of dollars to fund the development of specialized training courses for first responders to allow them to learn how to deal with fires at or near solar energy systems. The International Renewable Energy Council (IREC) offers free DOE-sponsored training course entitled, "Solar PV Safety for Firefighters."²³ That course provides answers to common questions, such as, "Can you spray water on solar panels?" and, "Is a roof top solar array hazardous on a cloudy day?"

Noise

Solar farms are very quiet. Solar facilities do produce some moderate noise, as described below, but since sound transmission over land drops dramatically with distance and is absorbed by any object in its path, including the solar array itself and any vegetative barriers along the property line, the result is that neighbors generally do not hear solar facilities at all.

There are two main sources of sound emanating from solar power generation equipment: the inverters and the transformers, although if a Battery Energy Storage System (BESS) is included in the project, it could also be a significant source of sound. Inverters only operate during the day, while transformers operate both day and night. Average sound levels at a distance of 10 feet from the inverter face vary over the range of 48 dB to 72 dB²⁴, which is about the same level of sound from a normal conversation, and it is less than the sound level of a toilet flushing²⁵. Step up transformers have noise levels that increase with size, with a maximum noise level of about 80 dBA at three feet for a large substation transformer²⁶. By way of comparison, OSHA requires employers to implement a hearing conservation program when noise exposure is at or above 85 decibels averaged over eight working hours²⁷, so in general, the sound levels inside a solar facility are not sufficient to require workers to employ hearing protection during normal operation.

Sound Level vs. Distance for Solar Equipment

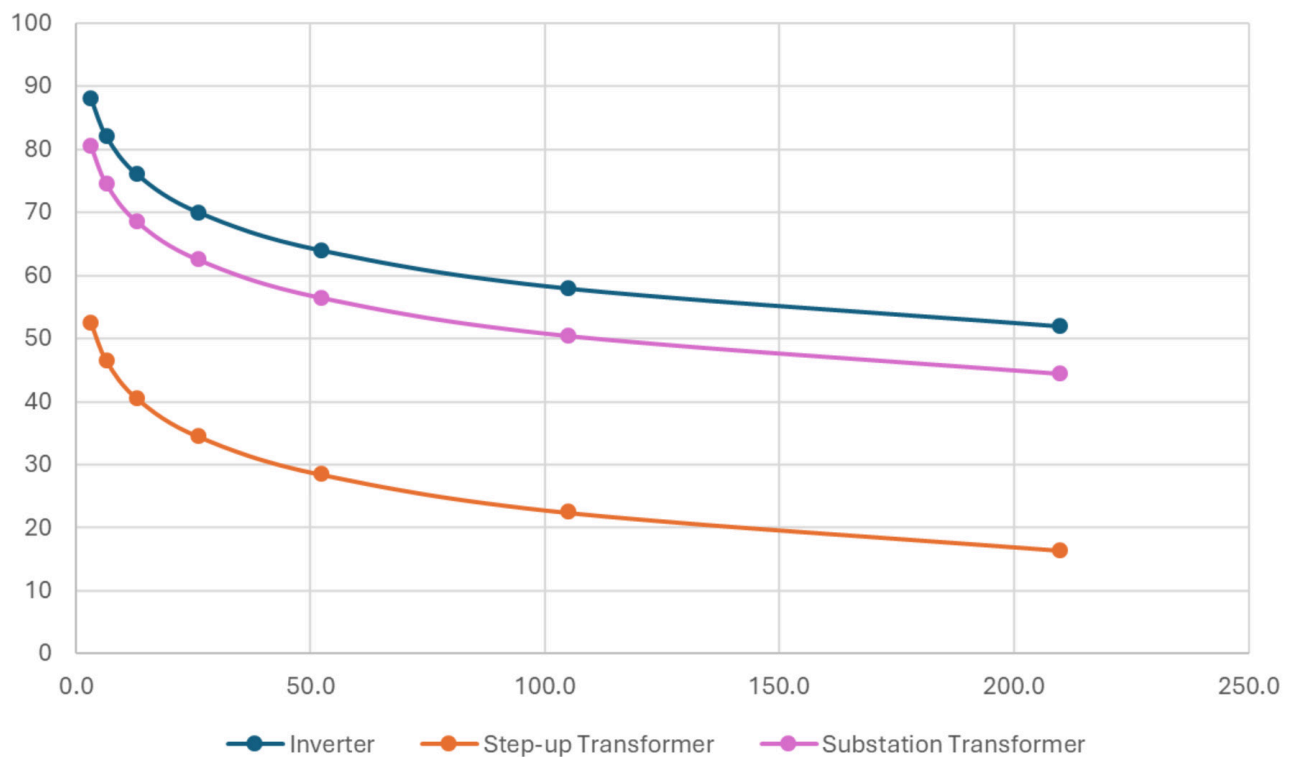


In a recent study of the acoustic impacts of solar power generation facilities²⁸, it was found that as long as large central inverters are located approximately 150 feet away from neighboring properties the sound levels will remain below the EPA recommended 55 dBA daytime limit. Smaller string inverters are so quiet that if they are used, they will not be audible at the fence line. The same is true for the smaller medium voltage transformers used within the solar field. If a substation with a high voltage transformer is built to connect to the transmission lines and it is located at least 200 feet away from neighboring properties, the sound levels will remain below the EPA recommended 45 dBA nighttime limit. These values could vary depending on the specific project, so many jurisdictions require a noise study to be conducted by a qualified engineer.

Land Use and Farming

Although the number is constantly changing, there are approximately 18 GW (18,000 MW) of solar projects in Louisiana that have been prospected and submitted to our regional grid operator, the Midcontinent Independent System Operator (MISO) for an interconnection permit, as shown in Figure 2 below. In reality, MISO data shows that only about 20% of the queue submittals are ever built for both technical and economic reasons. However, if we assume that all 18 GW of solar projects were actually built and we estimate an average of seven acres per MW, the proposed solar projects will use about 127,000 acres, out of approximately 8 million acres currently used for farm operations in Louisiana²⁹, representing an upper limit of approximately 1.6% of available farmland. However, if the historical average of 20% of proposed projects are built, that would represent 3.6 GW of solar energy, which would require approximately 25,000 acres, which is only 0.3% of Louisiana farmland, so it is unlikely that the proposed solar projects will significantly alter the agrarian nature of our state, and it seems unlikely that solar farms will create any serious difficulty for sugar cane or rice mills to receive enough product from nearby farms to remain profitable.

Current and Planned Solar Plants in Louisiana.

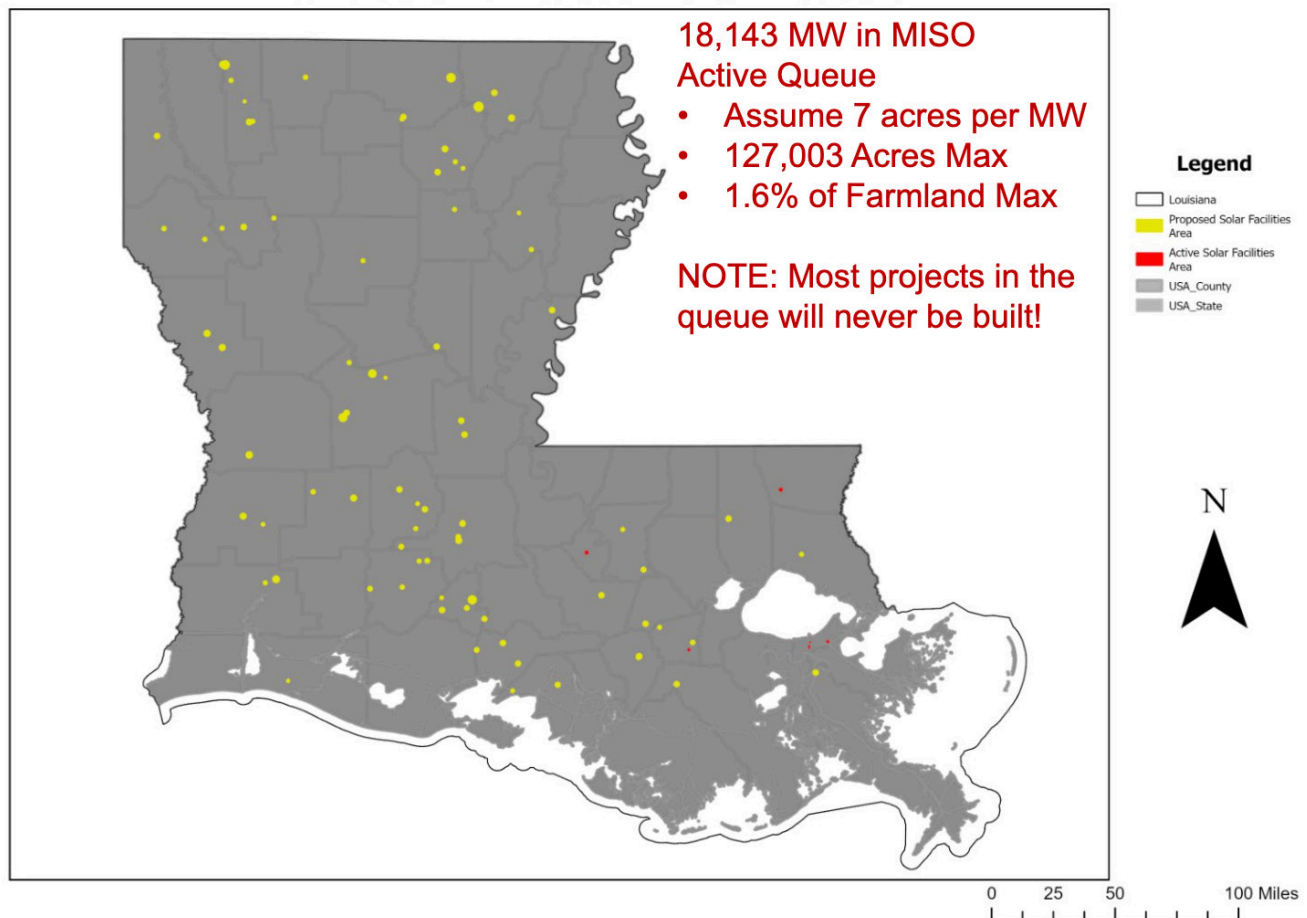

Three industry trends will also tend to reduce the amount of land used for solar in the future. One trend is that the efficiency of solar modules has been increasing rapidly over the last twenty years³⁰.

Another industry trend is to increase the Ground Coverage Ratio (GCR) in the design of the plant, which simply means that they are tending to put the rows of modules closer together to improve the cost-effectiveness of the projects. Since land use is directly related to module efficiency and ground coverage ratio, future solar farms will require less land to produce the same amount of electricity. Agrivoltaics, the combined use of the same land for both solar and agriculture, is a third emerging trend and an area of intense research sponsored by the US Department of Energy that might in the future provide new opportunities for Louisiana farmers. For example, UL Lafayette is currently studying the combined use of solar with crawfish farming. Solar farms have already been successfully combined with farm animals such as sheep as well as certain crops, and a large amount of research activity is currently being devoted to this topic.*Figure 2 - Map of Current and Planned Solar Projects in Louisiana*

When farmland is used for solar, the land lays fallow for 25 – 35 years with grass planted beneath the solar panels. This may actually improve the quality of the land once it is returned to agricultural use.

One issue that is of particular concern for Louisiana farmers, however, is the fact that many of our farmers do not own their own land; rather they lease, rent, or sharecrop the land that they farm. Since farm lease prices are typically significantly lower than solar lease prices, there is a real possibility that a tenant farmer could be priced out of the use of the land that they typically farm. This concern must be balanced against the right of the landowner to seek to maximize the return for their land. This balance of equities is an issue for local authorities to carefully consider when acting on a permit application for a solar farm.

Property Values

At the residential scale, researchers at the Lawrence Berkeley National Laboratory performed an “Analysis of the Effects of Residential Photovoltaic Energy Systems on Home Sales Prices in California,” and found that, “Across a large number of repeat sales model specifications and robustness tests, the analysis finds strong evidence that California homes with PV systems have sold for a premium over comparable homes without PV systems³¹.”

At the utility scale there is a common perception that utility-scale solar projects will bring down property values, even among appraisers. Researchers at the University of Texas at Austin surveyed land appraisers and found that, “while a majority of survey respondents estimated a value impact of zero, some estimated a negative impact associated with close distances between the home and the facility, and larger facility size. Regardless of these perceptions, geospatial analysis shows that relatively few homes are likely to be impacted³².”

For the UT-Austin study, however, it was found that those appraisers with a negative opinion had never actually performed a formal appraisal of a solar farm. However, when a study of the potential impact of a specific proposed solar farm at a particular site has been performed by certified appraisers, the results consistently show no negative effect on property values. For example, a State Certified General Appraiser in North Carolina was asked to do a study of the impact of nearby property values

of a proposed solar farm and his conclusion was:

“The matched pair analysis shows no impact in home values due to the adjacency to the solar farm as well as no impact to adjacent vacant residential or agricultural land. The criteria for making downward adjustments on property values such as appearance, noise, odor, and traffic all indicate that a solar farm is a compatible use for rural/residential transition areas³³.”

In a more recent case (2020) of the same type in Virginia, a professional appraiser was asked to:

“...provide our professional opinion on whether the proposed solar farm will have any impact on adjoining property values and whether “the location and character of the use, if developed according to the plan as submitted and approved, will be in harmony with the area in which it is to be located³⁴.”

The conclusion in Virginia was almost identical to that in North Carolina:

“Based on my analysis of the neighborhood and properties surrounding the proposed solar site, and my analysis of other existing solar farms in similar locations, it is our professional opinion that the proposed solar electric power plant will not adversely affect the value of adjoining or abutting property.

It is also my professional opinion that the location and character of the solar facility, if developed according to the plan as proposed, will be in harmony with the area in which it is to be located³².”

Codes and Standards

Building codes set minimum standards for the construction of buildings and other structures, including solar facilities, to safeguard the safety, health, and welfare of the public. In order to ensure the safe installation and operation of solar energy systems, building code requirements address issues such as the installation, materials, wind resistance, and fire classification.

Louisiana has enacted the Louisiana State Uniform Construction Code³⁵ and created the Louisiana State Uniform Construction Code Council³⁶, “to review and adopt the state uniform construction code, provide for training and education of code officials, and accept all requests for amendments of the code.” The Uniform Construction Code³⁷ incorporates by reference, with slight amendments, the International Building Code and the International Residential Code. The current versions of the International Residential Code and the International Building Code both require solar energy systems to be installed according to the manufacturer’s instructions, the National Electrical Code, and Underwriters Laboratories’ product safety standards. A partial list of the codes and standards that are applicable to solar energy equipment and installations is shown below.

□ Installation Requirements:

- National Electrical Code, NFPA 70
- Must be installed by a qualified person and in accordance with manufacturer's instructions

□ **Product Listings**

- UL 1703: Standard for Safety for Flat-Plate Photovoltaic Modules and Panels
- UL 1741: Standard for Inverters, Converters and Controllers for Use In Independent Power Systems
- IEEE 1547 - Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power Systems Interfaces

□ **Design Qualification (Reliability Testing)**

- IEC 61215: Crystalline Silicon Terrestrial Photovoltaic (PV) Modules - Design Qualification and Type Approval
- IEC 61646: Thin-Film Terrestrial Photovoltaic (PV) Modules - Design Qualification and Type Approval

□ **Performance Measurement**

- ASTM E1036: Standard Test Methods for Electrical Performance of Non-concentrator Terrestrial Photovoltaic Modules and Arrays Using Reference Cells

Taken together, the international and national codes and standards that have already been adopted in Louisiana, if enforced, will ensure that solar energy systems are safe. In general, the local Authority Having Jurisdiction (AHJ), such as the Parish or municipality, has the authority to enforce compliance with these codes and standards through the permitting and inspection process. The Solar Development Toolkit, an excellent resource developed specifically for Louisiana by the Center for Planning Excellence provides an overview of solar energy planning, zoning, codes, permitting, and inspections for local governments in Louisiana, and points to many available resources³⁸. The US DOE has also funded various resource guides for states and municipalities that could be consulted for more information, including, "Standards and Requirements for Solar Equipment, Installation, and Licensing and Certification - A Guide for States and Municipalities³⁹," and "Here Comes the Sun, A State Policy Handbook for Distributed Solar Energy⁴⁰."

Endnotes

- 1 Tommy Cleveland, "Health and Safety Impacts of Solar Photovoltaics," May 2017, White Paper published by the North Carolina Clean Energy Center, Available at: <https://nccleantech.ncsu.edu/wp-content/uploads/2019/10/Health-and-Safety-Impacts-of-Solar-Photovoltaics-PV.pdf>
- 2 Clean Energy Results Questions & Answers Ground-Mounted Solar Photovoltaic Systems, Massachusetts Department of Energy Resources, Massachusetts Department of Environmental Protection, Massachusetts Clean Energy Center, June 2015. Available at: <https://www.mass.gov/files/documents/2016/08/rn/solar-pv-guide.pdf>
- 3 Nover, Jessica, Renate Zapf-Gottwick, Carolin Feifel, Michael Koch, and Juergen H. Werner 2021. "Leaching via Weak Spots in Photovoltaic Modules" *Energies* 14, no. 3: 692. <https://doi.org/10.3390/en14030692>. Available at: <https://www.mdpi.com/1996-1073/14/3/692>
- 4 Gao, Qiao, Kirisits, Mary Jo, "The Effect of Photovoltaic Nanomaterial Roofing on Harvested Rainwater Quality," Project Number: University of Texas at Austin, USGS 104b Research Grant Final Report. Available at: <https://twri.tamu.edu/media/2021/gao-report.pdf>
- 5 Vasilis Fthenakis, "Sustainability of photovoltaics: The case for thin-film solar cells," *Renewable and Sustainable Energy Reviews*, Volume 13, Issue 9, 2009, Pages 2746-2750, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2009.05.001>. Available at: <https://www.sciencedirect.com/science/article/pii/S1364032109000896>
- 6 Vasilis M Fthenakis, "Life cycle impact analysis of cadmium in CdTe PV production," *Renewable and Sustainable Energy Reviews*, Volume 8, Issue 4, 2004, Pages 303-334, ISSN 1364-0321, <https://doi.org/10.1016/j.rser.2003.12.001>. Available at: <https://www.sciencedirect.com/science/article/pii/S1364032103001345>
- 7 "Human Health Risk Assessment Methods for PV Part 3: Module Disposal Risks 2020," International Energy Agency Photovoltaic Power Systems Programme, Report IEA-PVPS T12-16: 2020. Available at: https://iea-pvps.org/wp-content/uploads/2020/05/PVPS-Task-12_HHRA-PV-Disposal-1.pdf
- 8 C.C. Farrell, A.I. Osman, R. Doherty, M. Saad, X. Zhang, A. Murphy, J. Harrison, A.S.M. Vennard, V. Kumaravel, A.H. Al-Muhtaseb, D.W. Rooney, "Technical challenges and opportunities in realising a circular economy for waste photovoltaic modules," *Renewable and Sustainable Energy Reviews*, Volume 128, 2020, 109911, ISSN 1364-0321. Available at: <https://www.sciencedirect.com/science/article/pii/S1364032120302021>
- 9 Heath, G.A., Silverman, T.J., Kempe, M. et al. Research and development priorities for silicon photovoltaic module recycling to support a circular economy. *Nat Energy* 5, 502–510 (2020). Available at: <https://www.nature.com/articles/s41560-020-0645-2>
- 10 Meng Tao, Vasilis Fthenakis, Burcak Ebin, Britt-Marie Steenari, Evelyn Butler, Parikhit Sinha, Richard Corkish, Karsten Wambach, Ethan S. Simon, "Major challenges and opportunities in silicon solar module recycling," *Progress in Photovoltaics*, 22 July 2020, . Available at: <https://onlinelibrary.wiley.com/doi/full/10.1002/pip.3316>
- 11 "Recycling," First Solar Website, Accessed 7-26-2021, <https://www.firstsolar.com/en/Modules/Recycling>
- 12 "SEIA National PV Recycling Program," Solar Energy Industries Association Website, Accessed 7-26-2021. <https://seia.org/initiatives/seia-national-pv-recycling-program>
- 13 D.C. Jordan and S. R. Kurtz, "Reliability and Geographic Trends of 50,000 Photovoltaic Systems in the USA," Presented at the European Solar Energy Conference and Exhibition, Amsterdam, Netherlands, September 22 – 26, 2014, Available at: <https://www.nrel.gov/docs/fy14osti/62801.pdf>
- 14 EMF Electric and Magnetic Fields Associated with the Use of Electric Power, National Institute of Environ-

mental Health Sciences, National Institutes of Health, sponsored by the NIEHS/DOE EMF RAPID Program, Available at: https://www.niehs.nih.gov/health/materials/electric_and_magnetic_fields_associated_with_the_use_of_electric_power_questions_and_answers_english_508.pdf

15 World Health Organization. Electromagnetic Fields and Public Health: Exposure to Extremely Low Frequency Fields. June 2007. Accessed July 2021. <http://www.who.int/peh-emf/publications/facts/fs322/en/>

16 Committee on the Possible Effects of Electromagnetic Fields on Biologic Systems, National Research Council, Possible Health Effects of Exposure to Residential Electric and Magnetic Fields, ISBN: 0-309-55671-6, 384 pages, 6 x 9, (1997) This PDF is available from the National Academies Press at: <http://www.nap.edu/catalog/5155.html>

17 IEEE: "IEEE Standard for Safety Levels with Respect to Human Exposure to Radio Frequency Electromagnetic Fields, 3 kHz to 300 GHz." New York: Institute of Electrical and Electronic Engineers, IEEE Std. C95.1, 2005. Available at: https://standards.ieee.org/standard/C95_1-2019.html

18 International Commission on Non-Ionizing Radiation Protection (ICNIRP): Guidelines for limiting exposure to time-varying electric and magnetic fields (1 Hz to 100 kHz). Health Phys. 99(6):818–836 (2010). Available at: https://journals.lww.com/health-physics/Citation/2010/12000/GUIDELINES_FOR_LIMITING_EXPOSURE_TO_TIME_VARYING.26.aspx

19 US DOE Letter from John Lushetsky, Program Manager, U.S. Department of Energy Solar Technologies Program, dated 12 Nov 2009. Available at: <https://westbrookfieldsolar.files.wordpress.com/2012/03/us-doe-letter-on-solar-safety.pdf>

20 "Scaling Public Concerns of Electromagnetic Fields Produced by Solar Photovoltaic Arrays," Good Company, Eugene, OR, available at: <https://www.gusd.net/cms/lib/CA01000648/Centricity/Domain/53/7.%20OR%20EMF%20concerns.pdf>

21 R. A. Tell, H. C. Hooper, G. G. Sias, G. Mezei, P. Hung & R. Kavet ,(2015), "Electromagnetic Fields Associated with Commercial Solar Photovoltaic Electric Power Generating Facilities," Journal of Occupational and Environmental Hygiene, 12:11, 795-803, DOI: 10.1080/15459624.2015.1047021, available at: <https://www.tandfonline.com/doi/full/10.1080/15459624.2015.1047021>

22 "Real-life experience of interference with Implanted Heart Devices," EMFs.info Website, Accessed 7-26-2021. Available at: <https://www.emfs.info/effects/medical-devices/real-life-experience-interference-implanted-heart-devices/>

23 "Solar PV Safety for Firefighters," Interstate Renewable Energy Council (IREC), Albany, NY, Accessed 7-26-2021, https://cleanenergytraining.org/products/solar-pv-safety-for-firefighters#tab-product_tab_contents_20

24 "Study of Acoustic and EMF Levels from Solar Photovoltaic Projects," Report Prepared for the Massachusetts Clean Energy Center, Boston, MA, by Tech Environmental, Waltham, MA, December 17, 2021, . Available at: <https://files.masscec.com/research/StudyAcousticEMFLevelsSolarPhotovoltaicProjects.pdf>

25 Noise Level Chart Website, Accessed 7-26-2021, <https://www.noisehelp.com/noise-level-chart.html>

26 NEMA Standards Publication TR 1-2013 (R2019), "Transformers, Step Voltage Regulators and Reactors," National Electrical Manufacturers Association, 1300 North 17th Street, Suite 900, Rosslyn, VA 22209.

27 "Occupational Noise Exposure," OSHA Website, Accessed 7-26-2021. <https://www.osha.gov/noise>

28 Chambers, T. L., Mehraeen, S., 2024, "A Brief Study of the Acoustic Impacts of Solar Power Generation Facilities," available at: <https://eese.louisiana.edu/sites/eese/files/A%20Brief%20Study%20of%20the%20Acoustic%20Impacts%20of%20Solar%20Power%20Generation%20Facilities.pdf>

29 2020 State Agriculture Overview, United States Department of Agriculture National Agricultural Statis-

tics Service Website, Accessed 7-28-2021. https://www.nass.usda.gov/Quick_Stats/Ag_Overview/stateOverview.php?state=LOUISIANA

30 Best Research-Cell Efficiency Chart, National Renewable Energy Lab, Available at: <https://www.nrel.gov/pv/cell-efficiency.html>

31 Ben Hoen, Ryan Wiser, Peter Cappers and Mark Thayer, "An Analysis of the Effects of Residential Photovoltaic Energy Systems on Home Sales Prices in California," Environmental Energy Technologies Division, Ernest Orlando Laboratory, Lawrence Berkeley National Laboratory, April 2011. Available at: <https://eta-publications.lbl.gov/sites/default/files/lbnl-4476e.pdf>

32 Leila Al-Hamoodah, Kavita Koppa, Eugenie Schieve, D. Cale Reeves, Ben Hoen, Joachim Seel and Varun Rai, An Exploration of Property-Value Impacts Near Utility-Scale Solar Installations, Policy Research Project (PRP), LBJ School of Public Affairs, The University of Texas at Austin, May 2018. Available at: https://emp.lbl.gov/sites/default/files/property-value_impacts_near_utility-scale_solar_installations.pdf

33 Richard C. Kirkland, Jr., MAI, "Oakwood Solar Impact Study," Kirkland Appraisals, LLC, Raleigh North Carolina, February 12, 2016, Available at: <https://usesusa.org/wp-content/uploads/2020/02/Solar-Impact-Study.pdf>

34 Christian P. Kaila & Associates, "PROPERTY IMPACT ANALYSIS Of Proposed Maroon Solar Farm Raccoon Ford Road Culpeper County, Virginia," Christian P. Kaila & Associates, Fredericksburg, VA, Available at: <https://www.maroon-solarproject.com/wp-content/uploads/2021/01/Attachment-M-Property-Value-Impact-Study-P1007432.pdf>

35 Louisiana State Uniform Construction Code, RS 40:1730.21, <http://lsuccc.dps.louisiana.gov/pdf/LA%20State%20Uniform%20Construction%20Code%202011.pdf>

36 Louisiana State Uniform Construction Code Council, <http://lsuccc.dps.louisiana.gov/index.html>

37 Uniform Construction Code, http://lsuccc.dps.louisiana.gov/pdf/UC_Codes_Amendments_2020.pdf

38 <https://www.cpex.org/louisiana-model-solar-ordinance>

39 Beren Argetsinger, Benjamin Inskeep, "Standards and Requirements for Solar Equipment, Installation, and Licensing and Certification - A Guide for States and Municipalities," February 2017, A Report Prepared for the Clean Energy States Alliance with Funding from the DOE SunShot Program, Available at: <https://www.cesa.org/wp-content/uploads/Standards-and-Requirements-for-Solar.pdf>

40 "Here Comes the Sun, A State Policy Handbook for Distributed Solar Energy," National Conference of State Legislatures and National Association of State Energy Officials, July 2017. Available at: <https://naseo.org/data/sites/1/documents/publications/Here%20Comes%20the%20Sun%20Handbook%20July%202017.pdf>